

SPA EXPLOSION PROOF - REQUEST FORM FOR CONTROL STATION

Instructions



Fill in the chart to the left according to the number of control elements required (2, 4, 6, 8, 10 or 12 actuators).

- 1 Protection:** tick the box corresponding to the type of protection required.
- 2 Control elements:** enter in the broken-line box the number corresponding to the control element required (1 to 13).
If you choose **buttons with arrows**, enter the direction of the arrow into the corresponding box. Eg. ↗
ATTENTION: buttons with opposite functions (eg.: up/down) must be vertically coupled in columns.
When mounting **mushroom pushbuttons** or **selector switches**, the corresponding rocker button is disabled.
- 3 Options:** tick the box corresponding to the options you may require.


1 Protection	
<input type="checkbox"/>	Ex II 2 G II 2 D Ex d IIB T6 Gb Ex tb IIIC T85°C Db IP 65 / IP 66 Enclosure group II B
<input type="checkbox"/>	Ex II 2 G II 2 D Ex d IIC T6 Gb Ex tb IIIC T85°C Db IP 65 / IP 66 Enclosure group II C

2 Control elements	
ATTENTION: depending on the functions of the control elements chosen, either 1 speed or 2 speed switches will be used.	
[]	Emergency stop mushroom pushbutton
[]	Selector switch - 2 maintained positions 0/1
[]	Selector switch - 3 maintained positions 0/1/2
[]	Key selector switch - 2 maintained positions 0/1
1 speed buttons	
[]	
[]	
[]	
[]	
[]	
[]	
[]	
[]	
[]	
2 speed buttons	
[]	

3 Options	
<input type="checkbox"/>	Enclosure in stainless steel AISI 316
<input type="checkbox"/>	Enclosure in chrome-plated cast-iron
<input type="checkbox"/>	Operational ambient temperature -50° C/+55°C

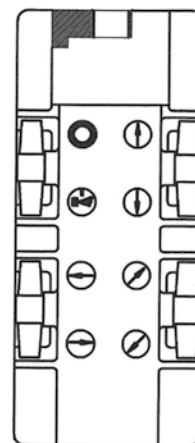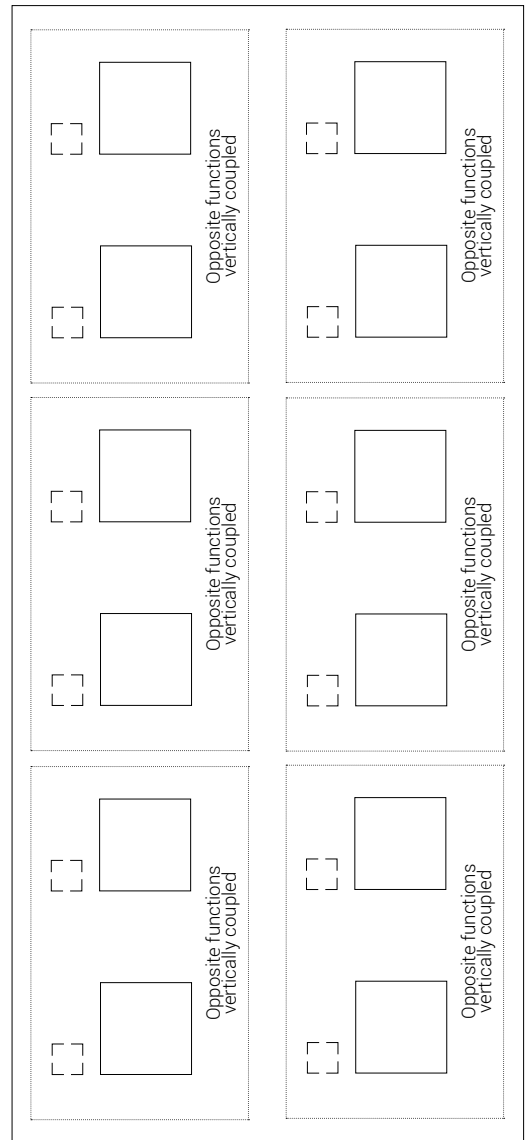

2-8 actuators

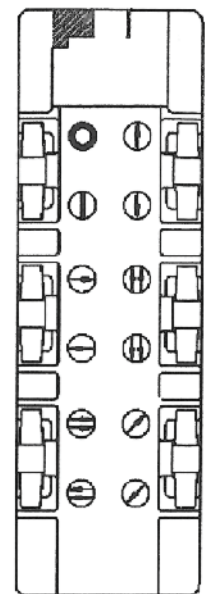

10-12 actuators